

Figure 1

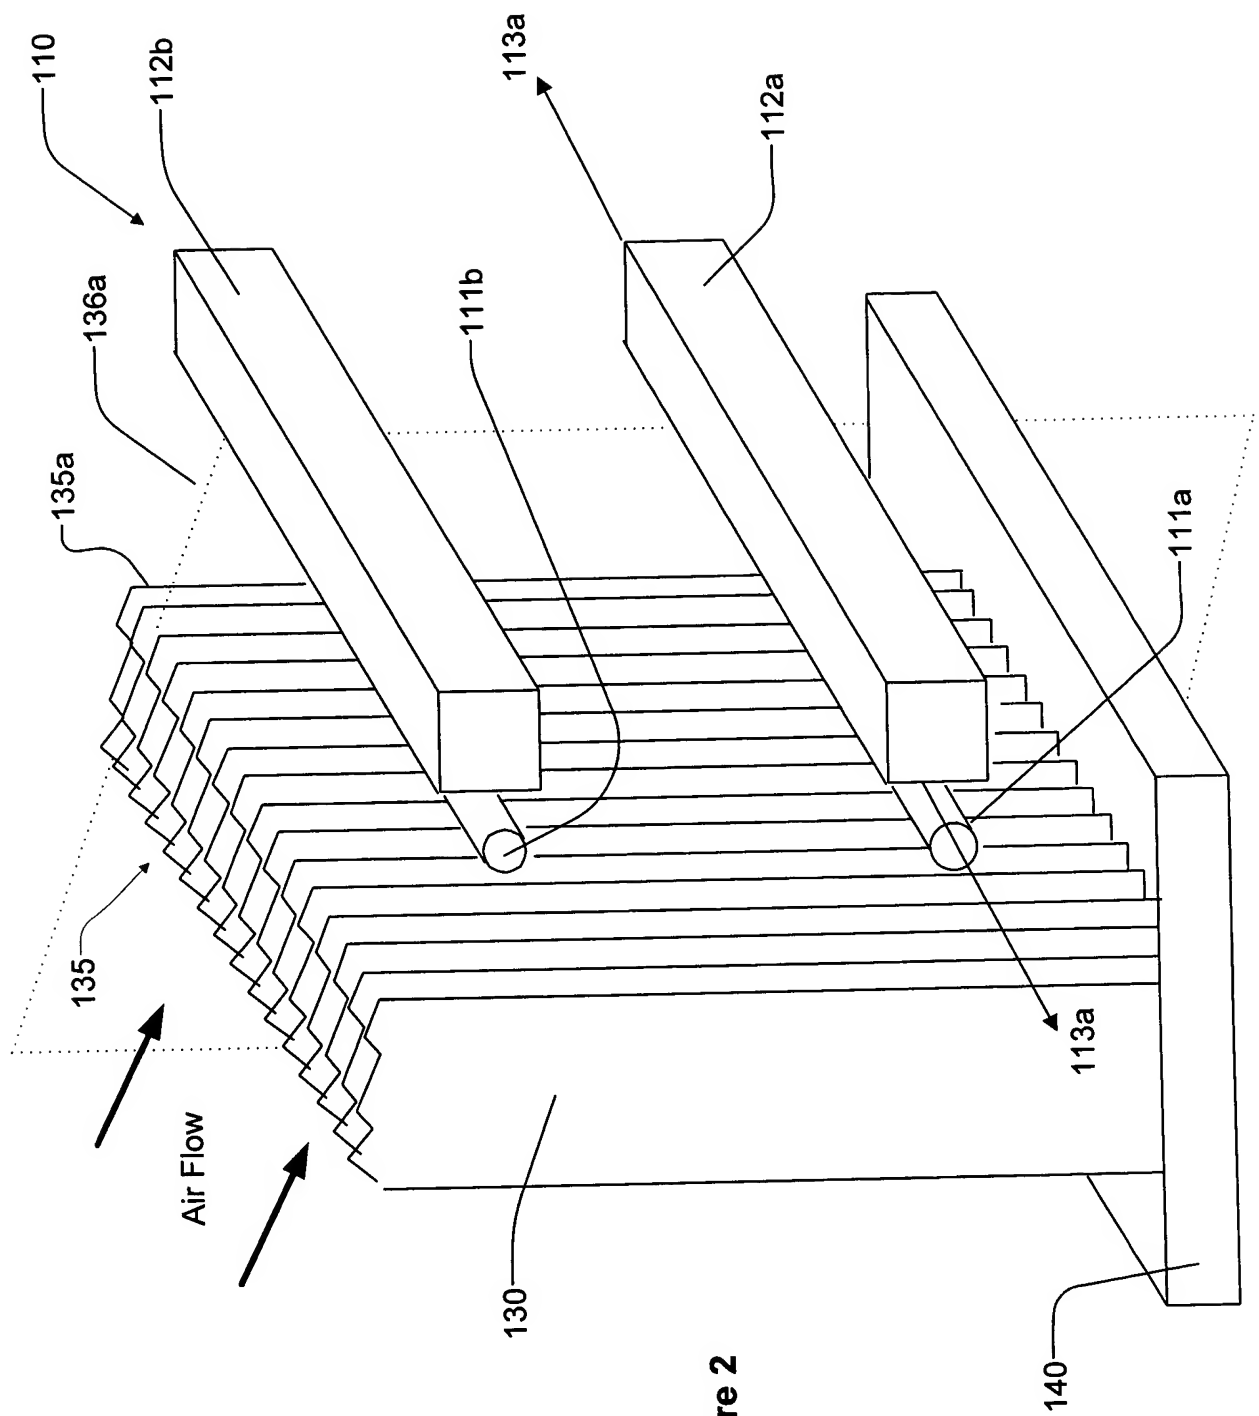


Figure 2

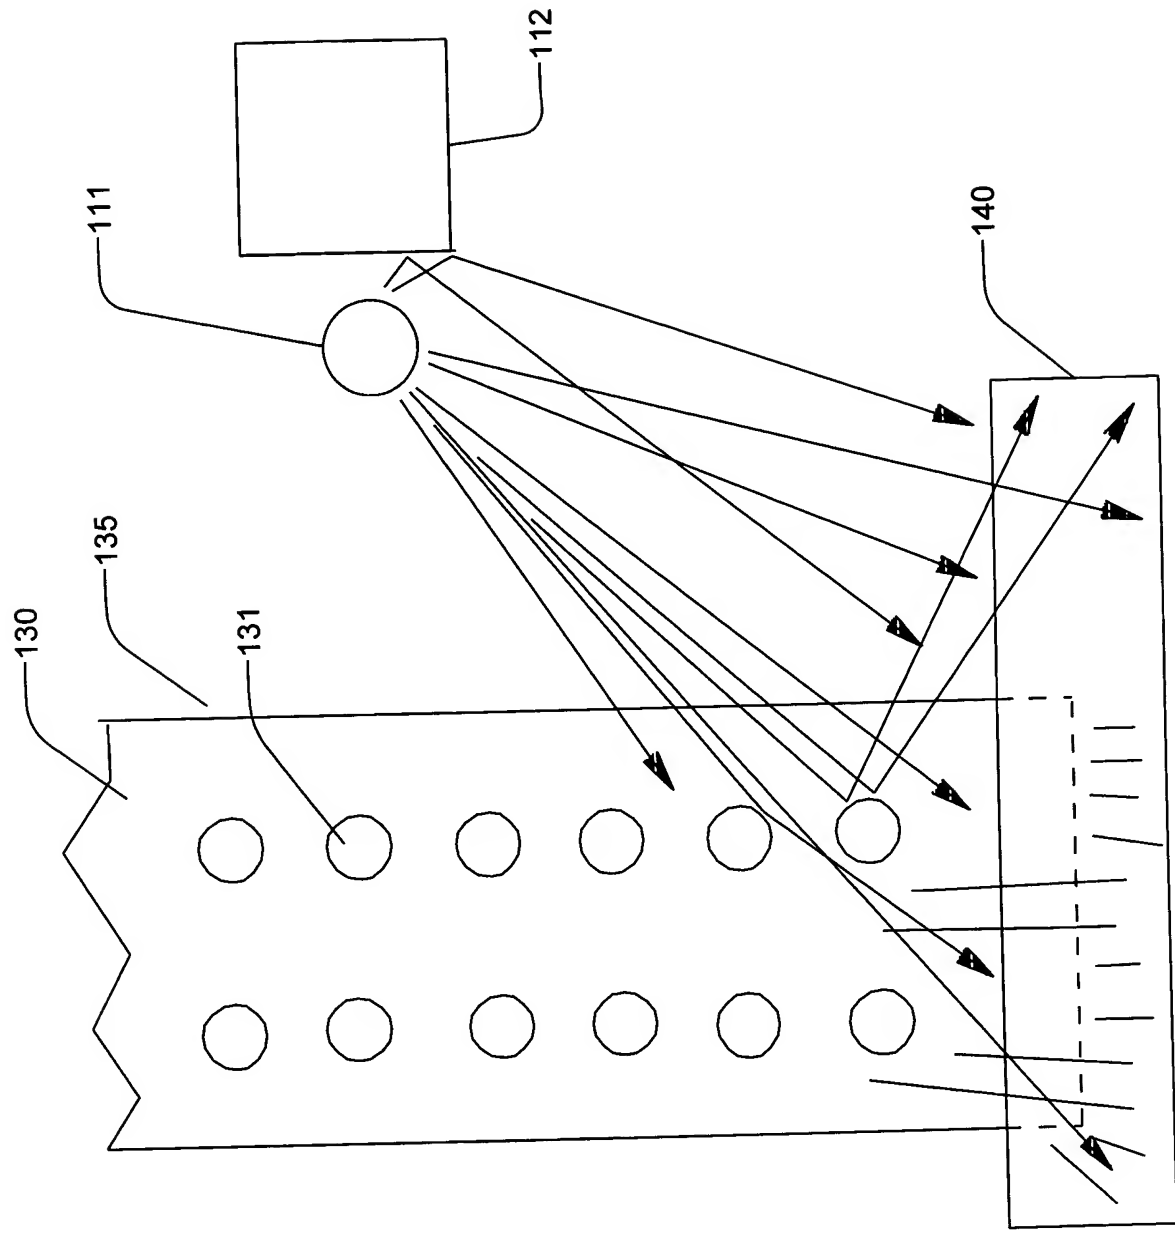


Figure 3

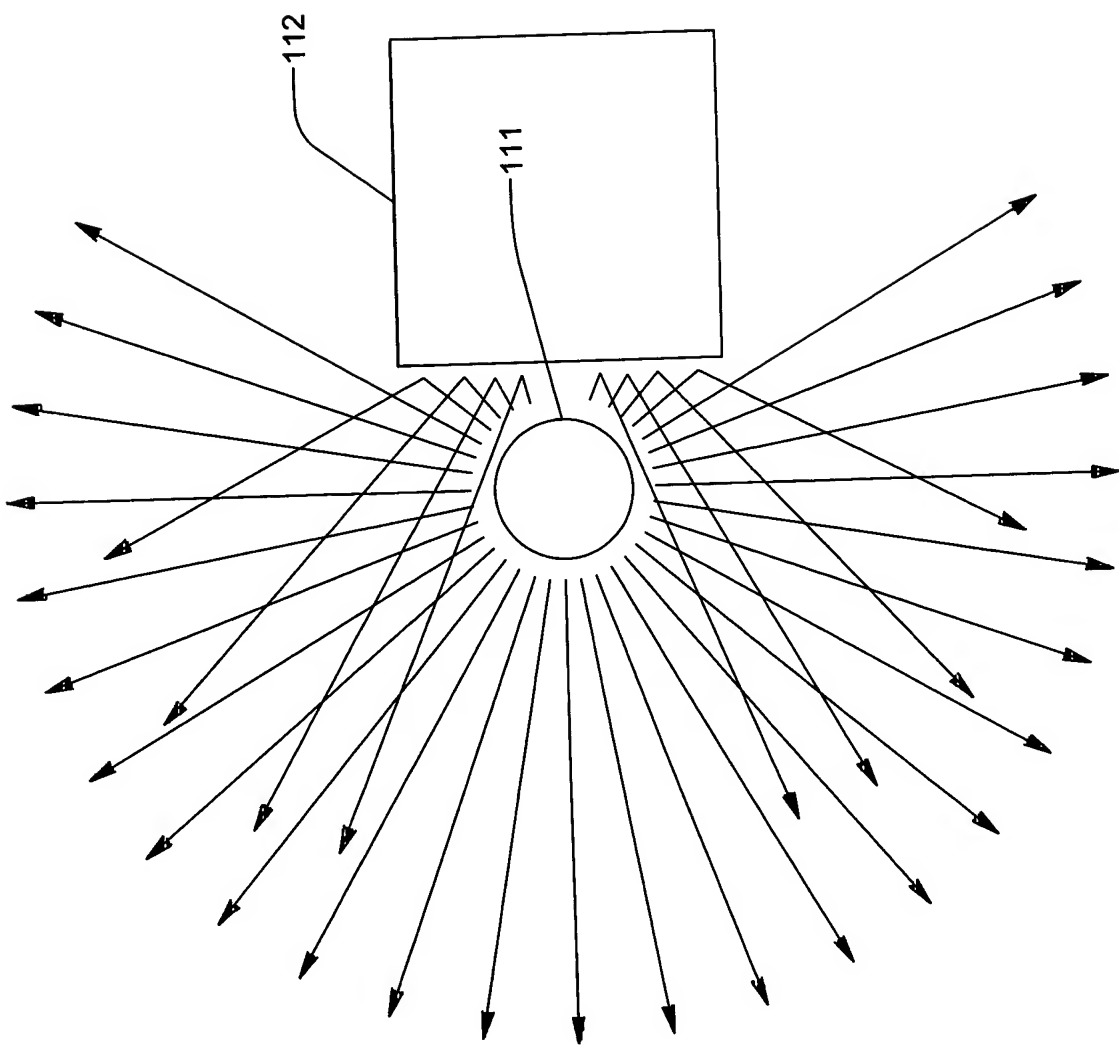


Figure 4

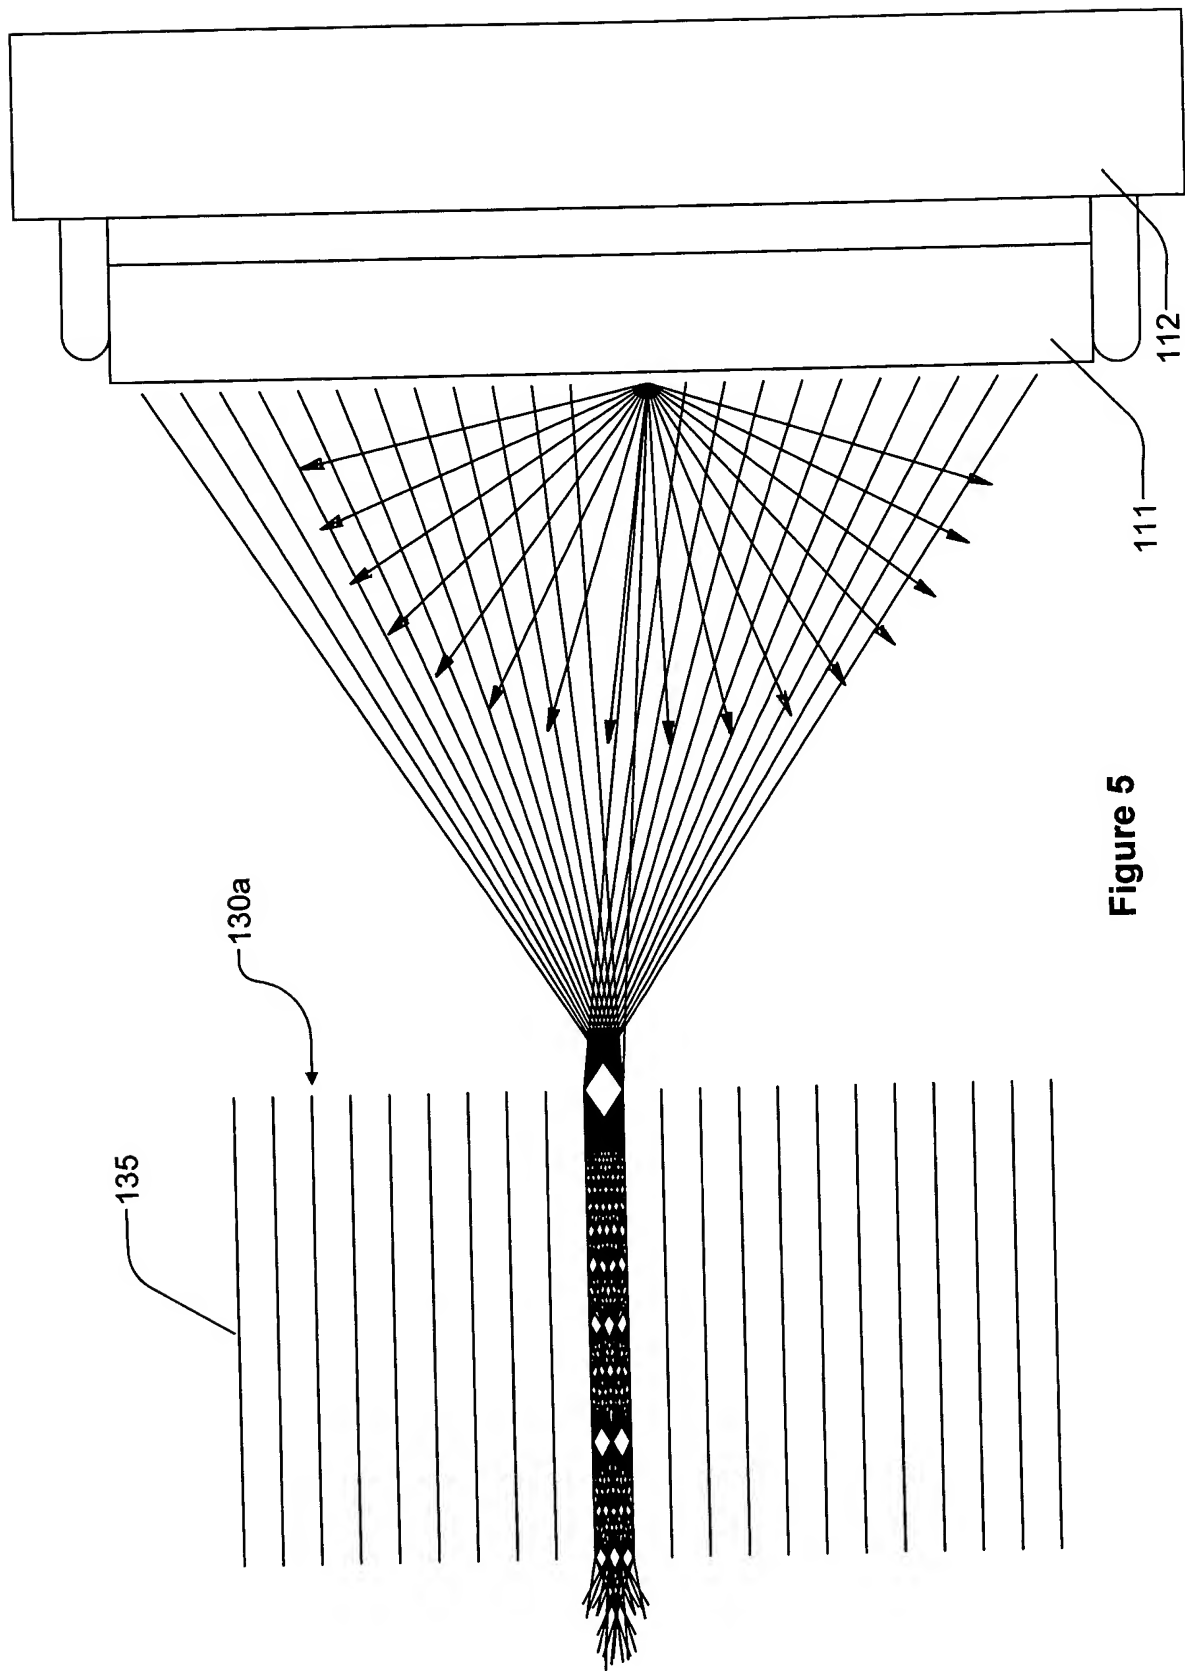


Figure 5

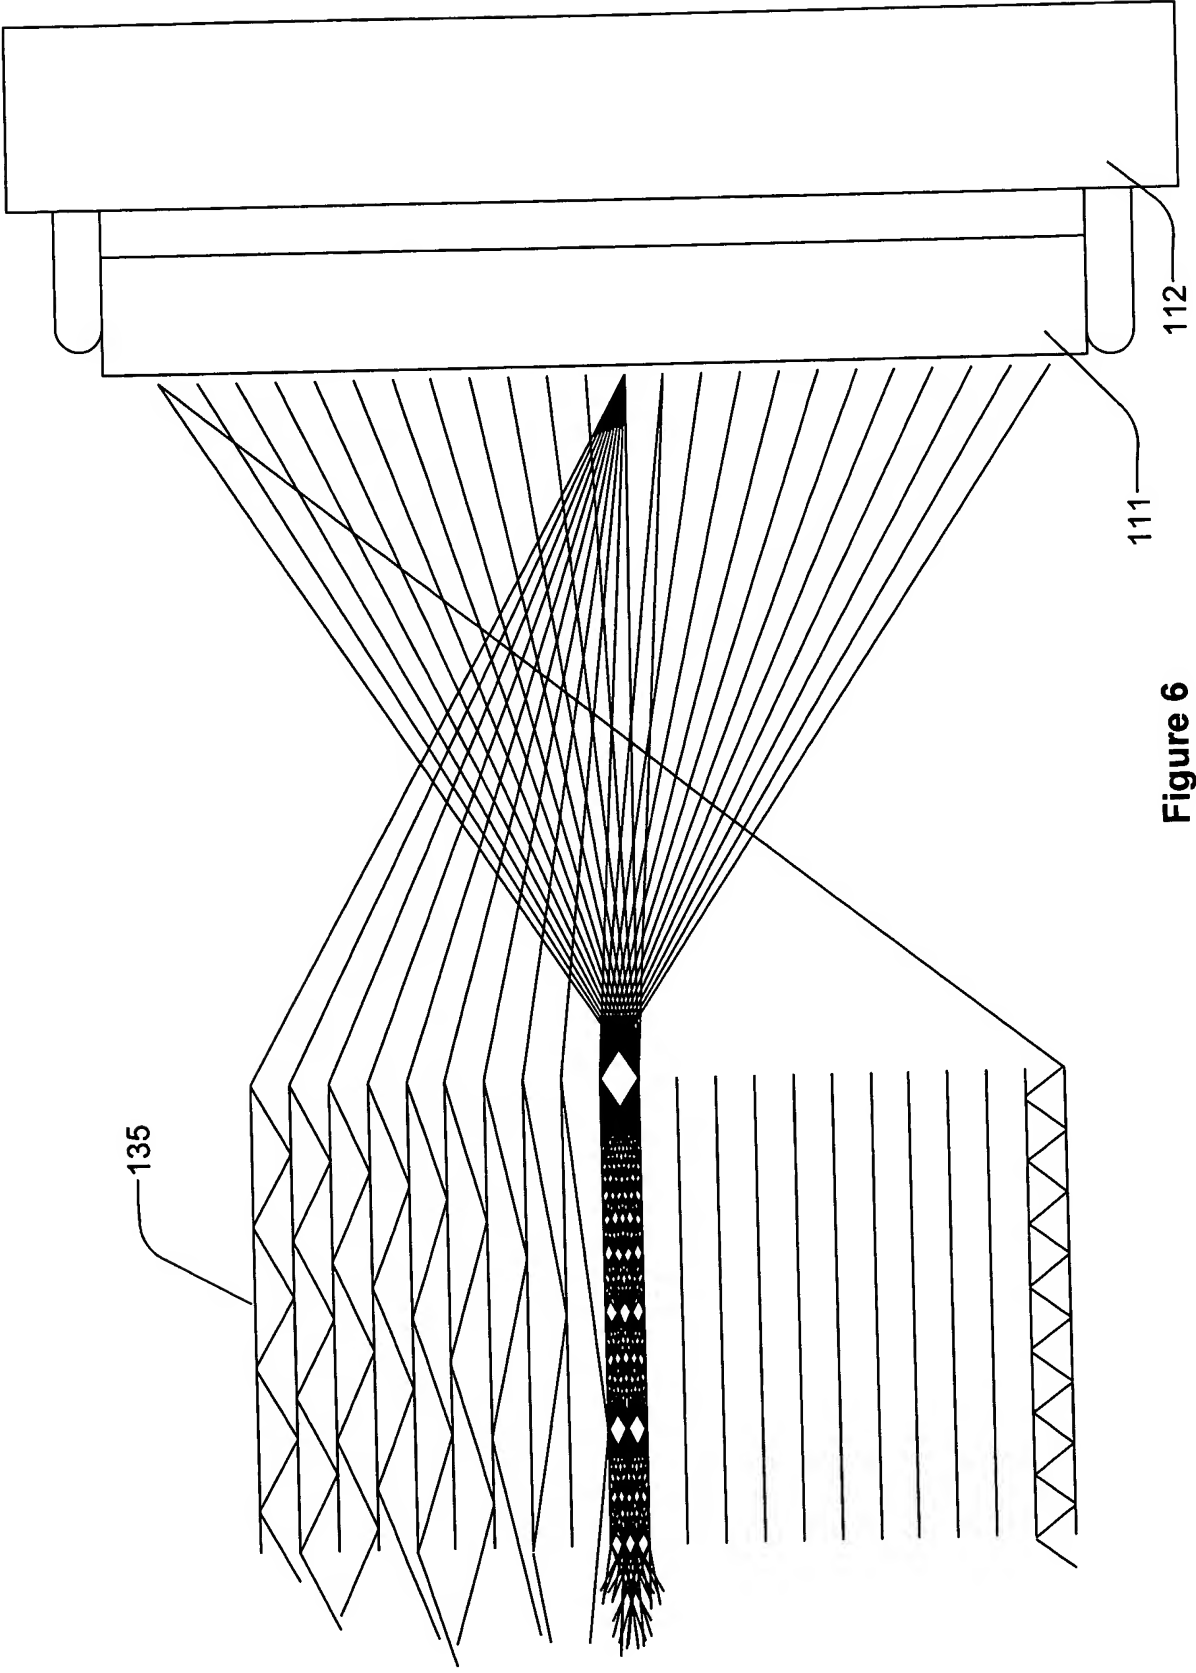


Figure 6

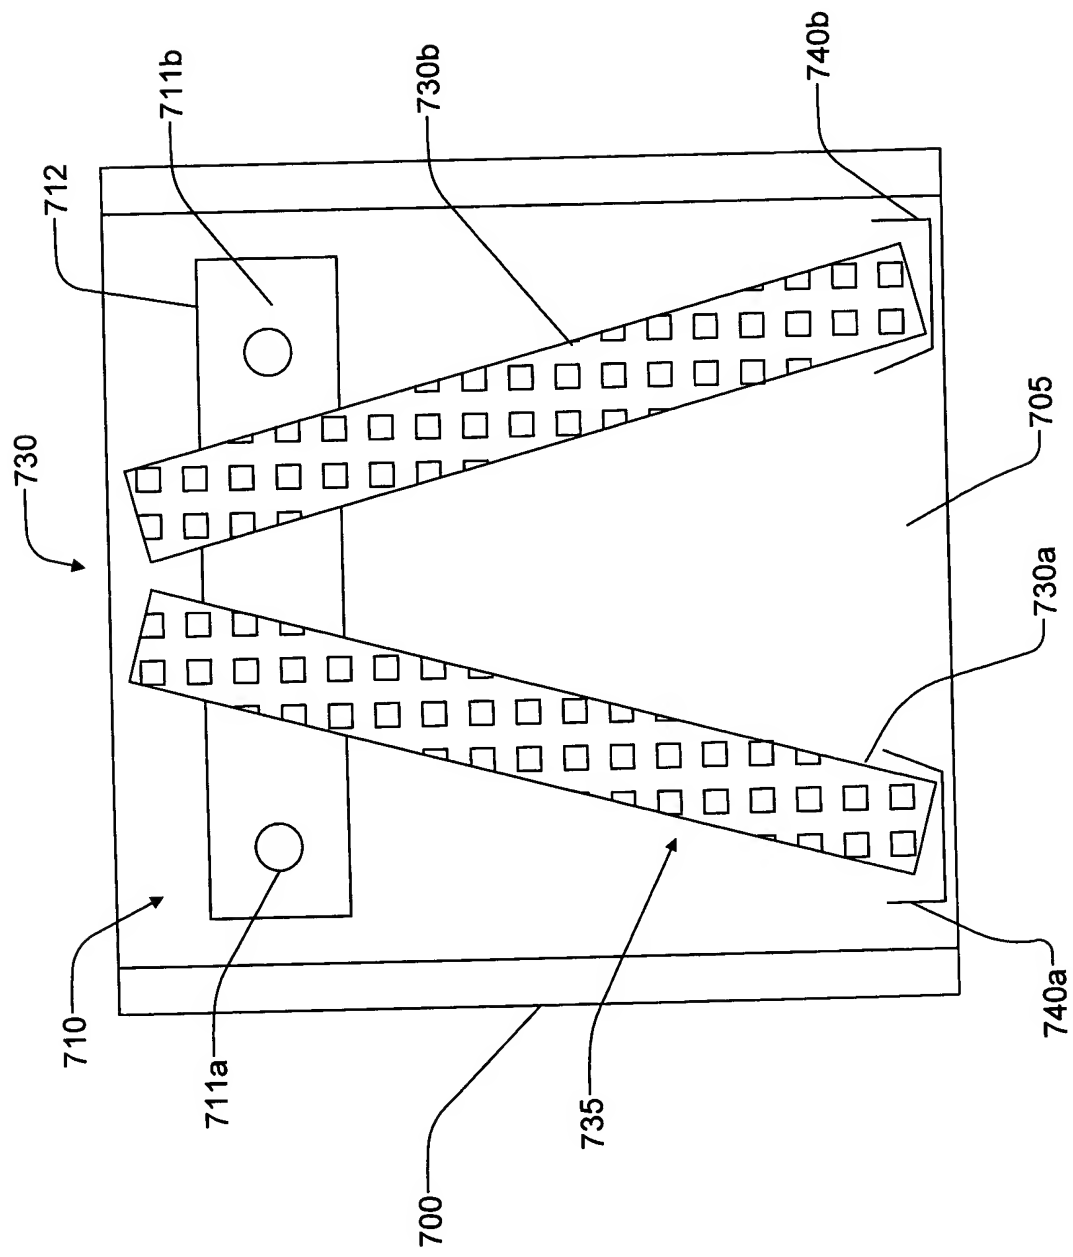


Figure 7

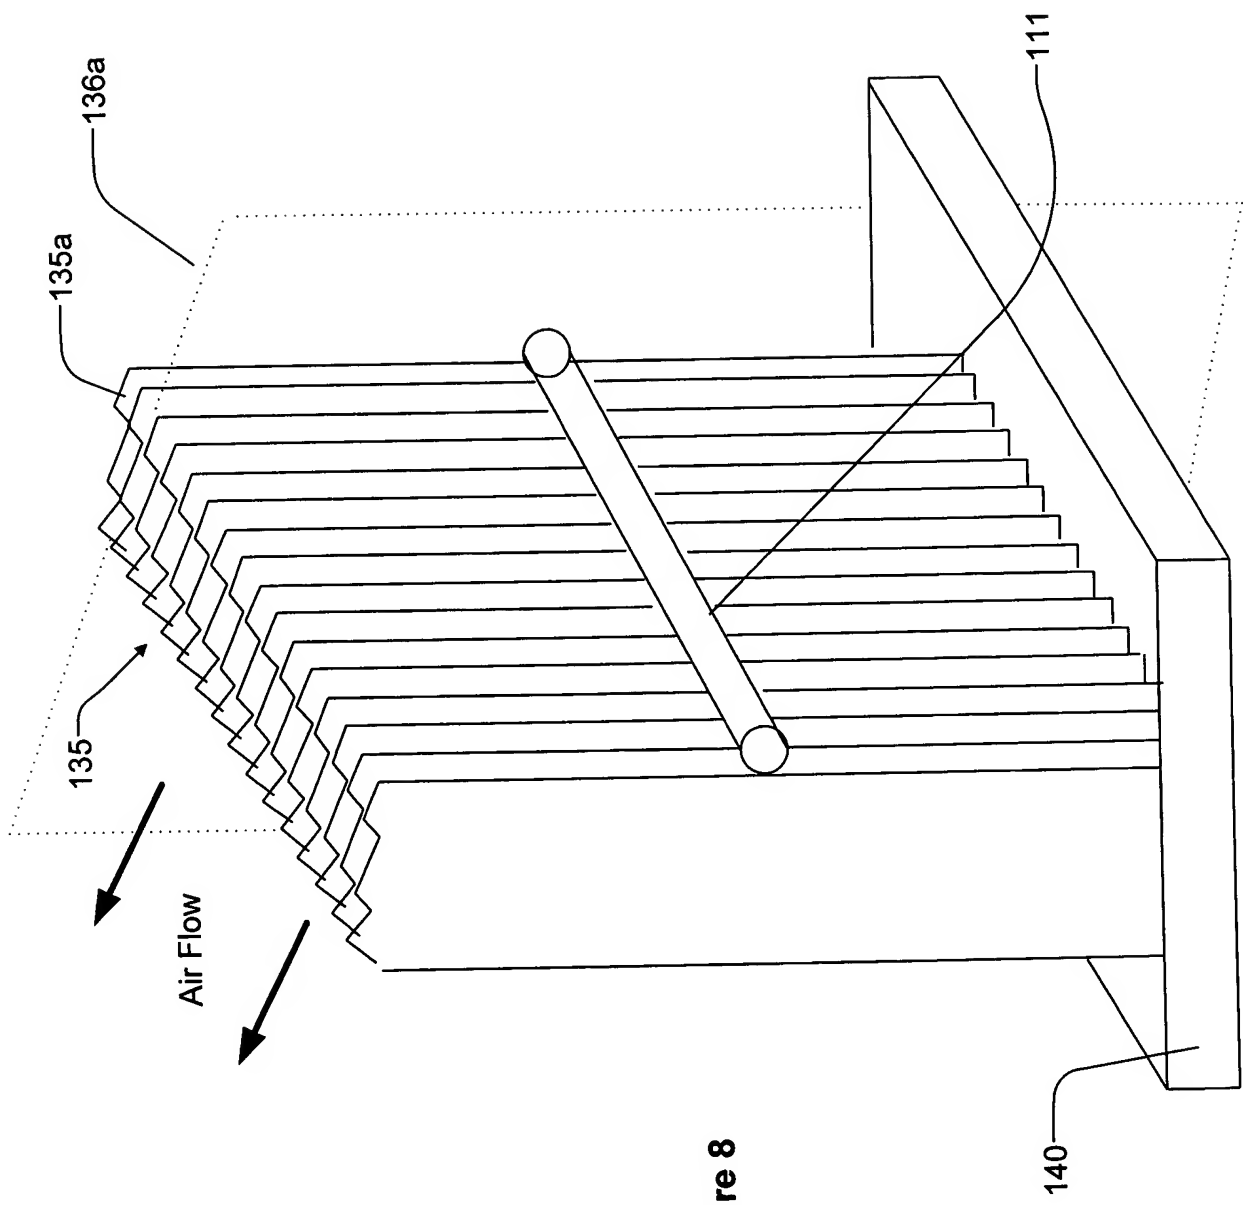


Figure 8

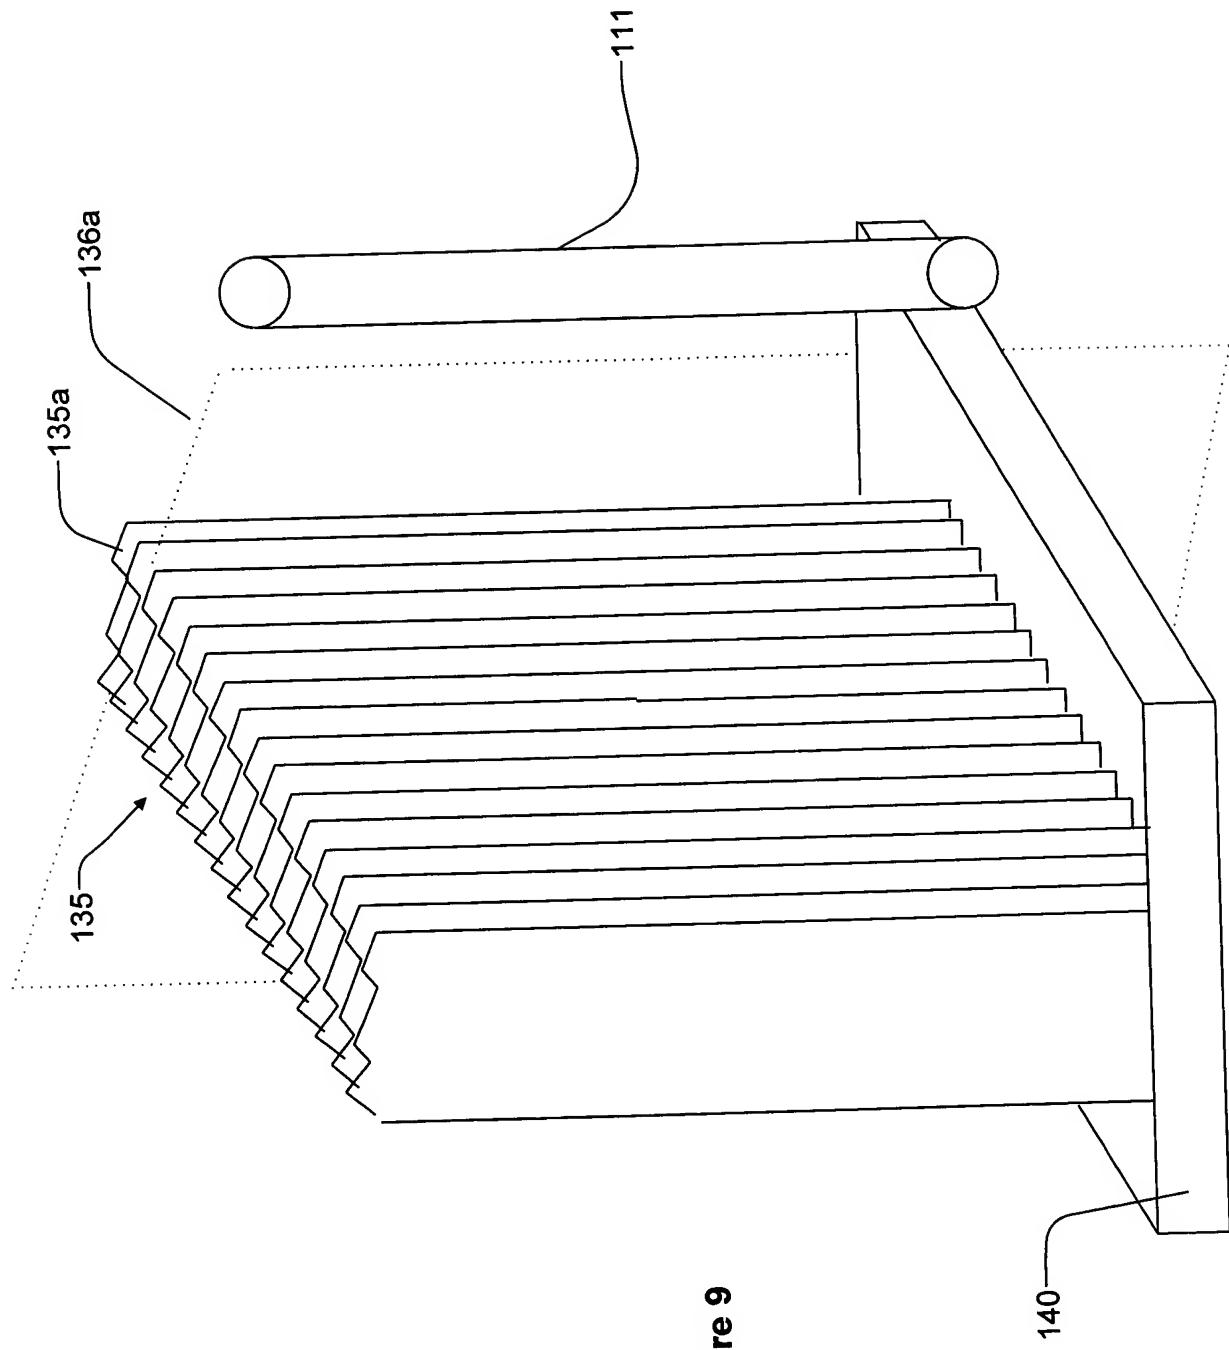


Figure 9

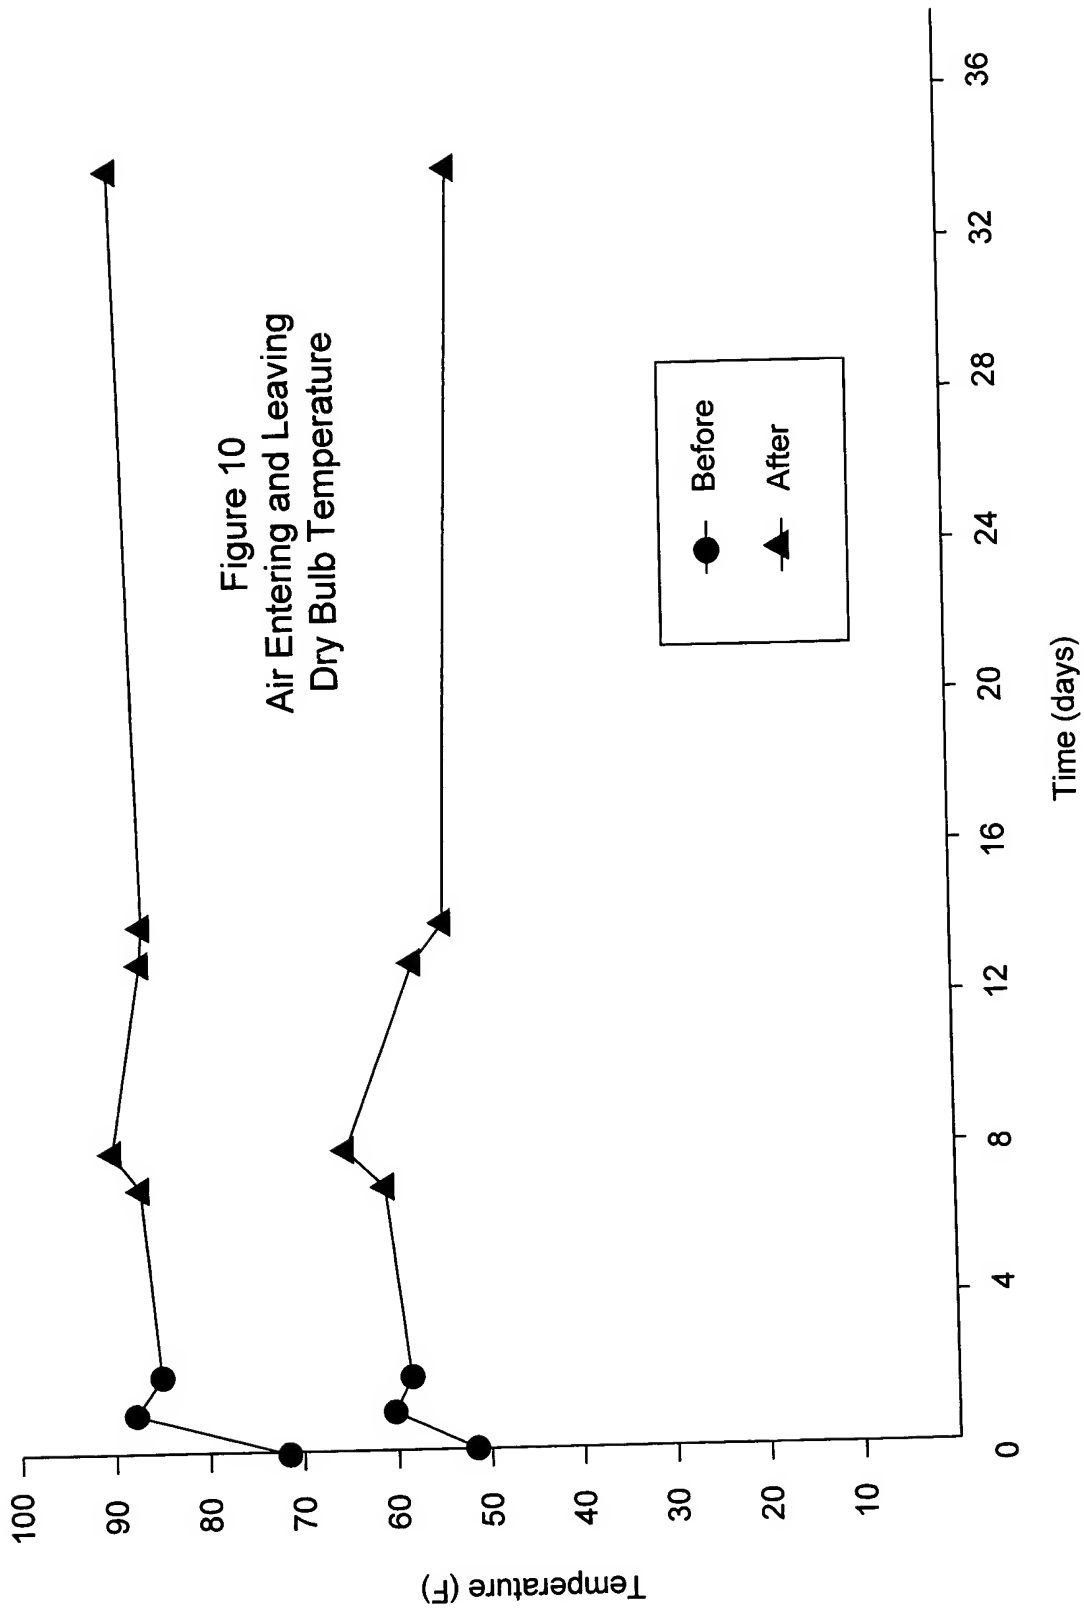


Figure 11
Cooling Coil Pressure Drop (DX)

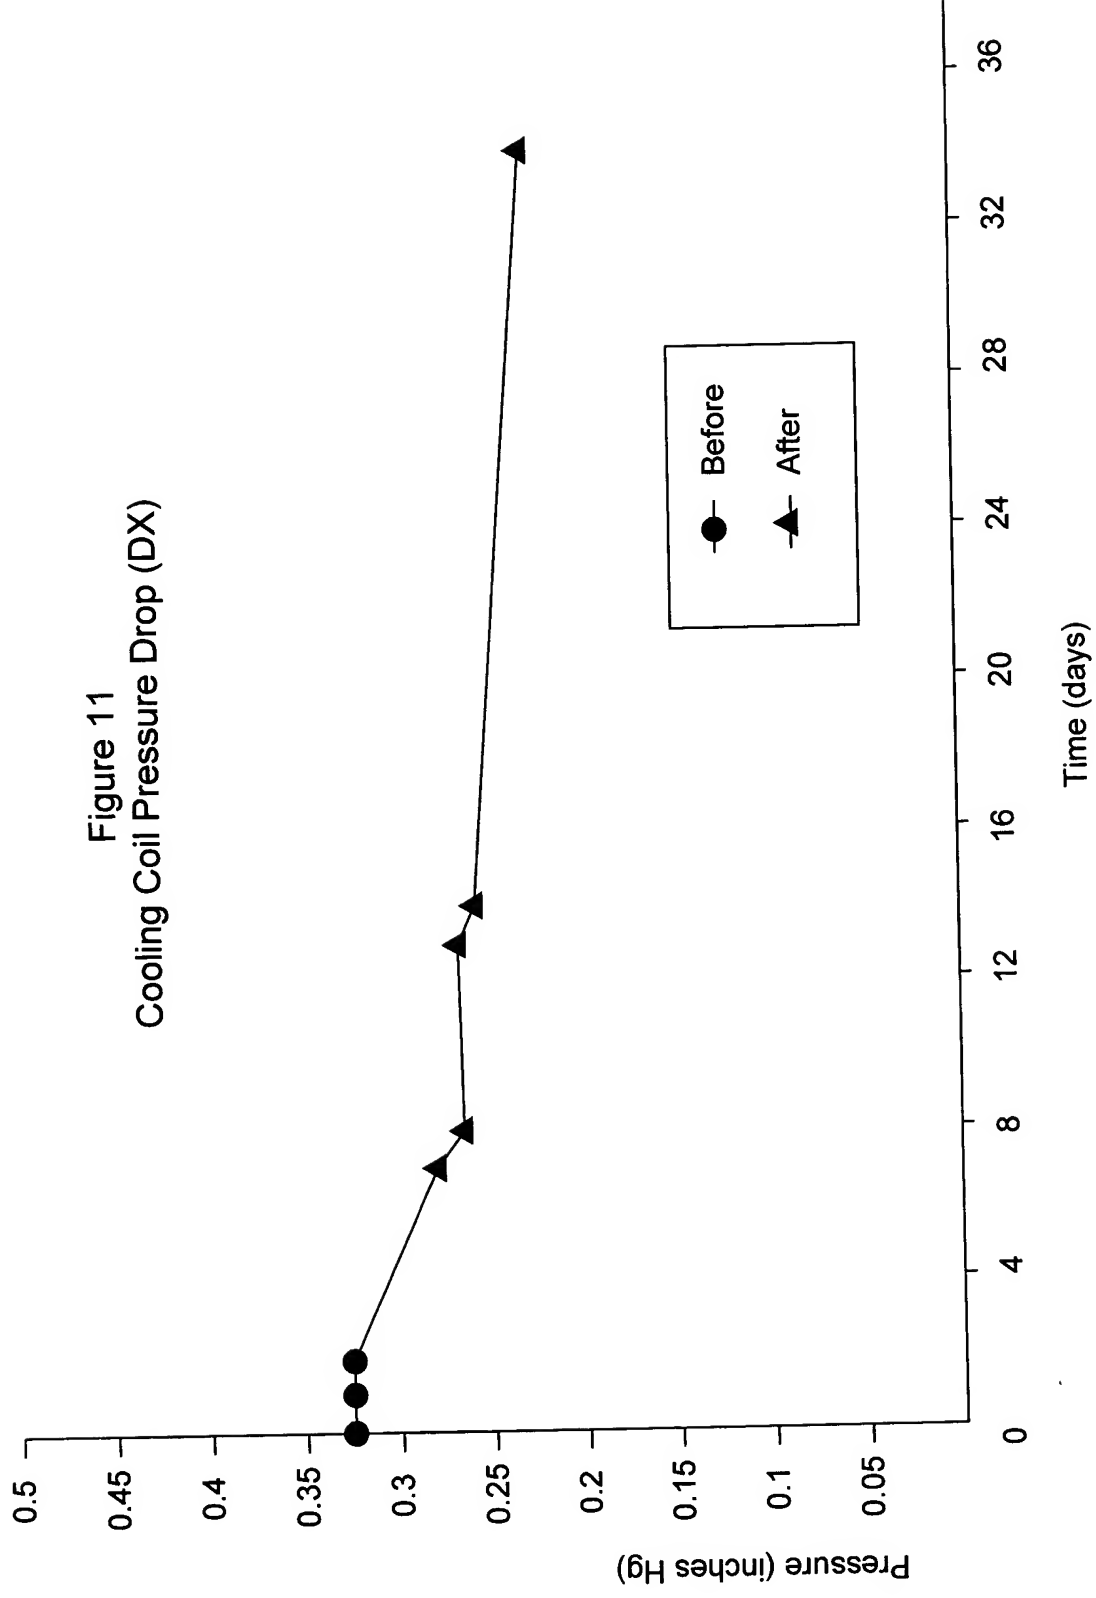


Figure 12
Air Entering and Leaving
Wet Bulb Temperature

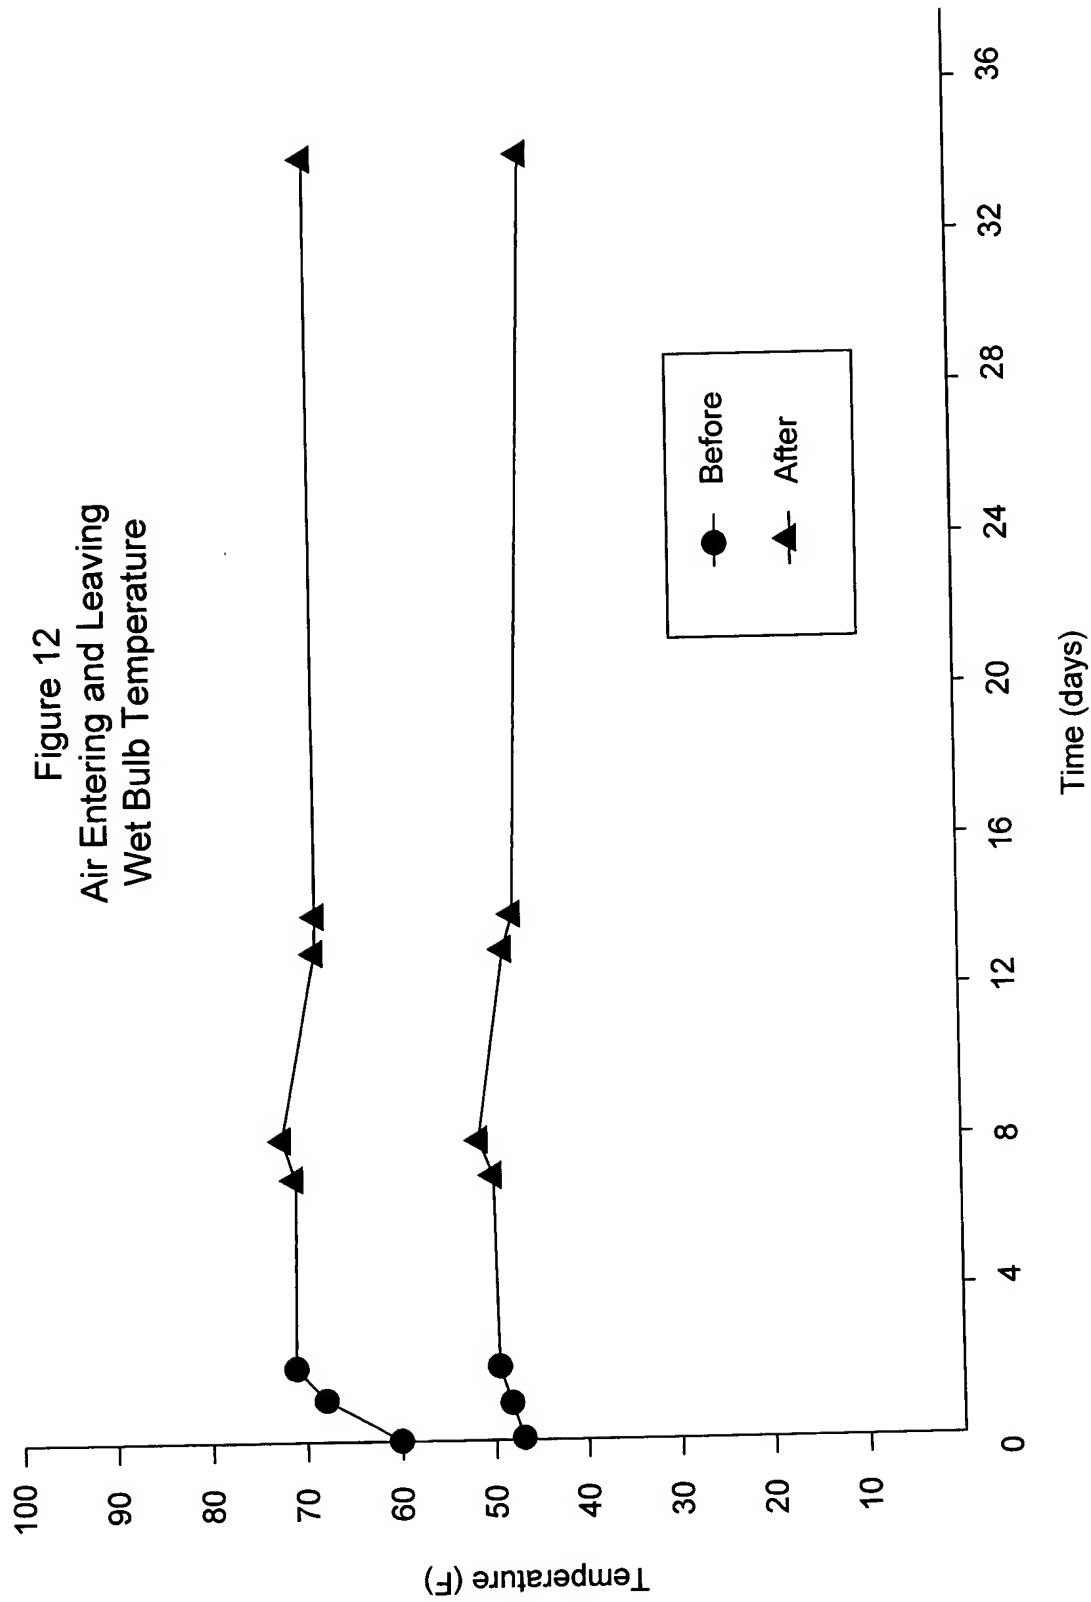
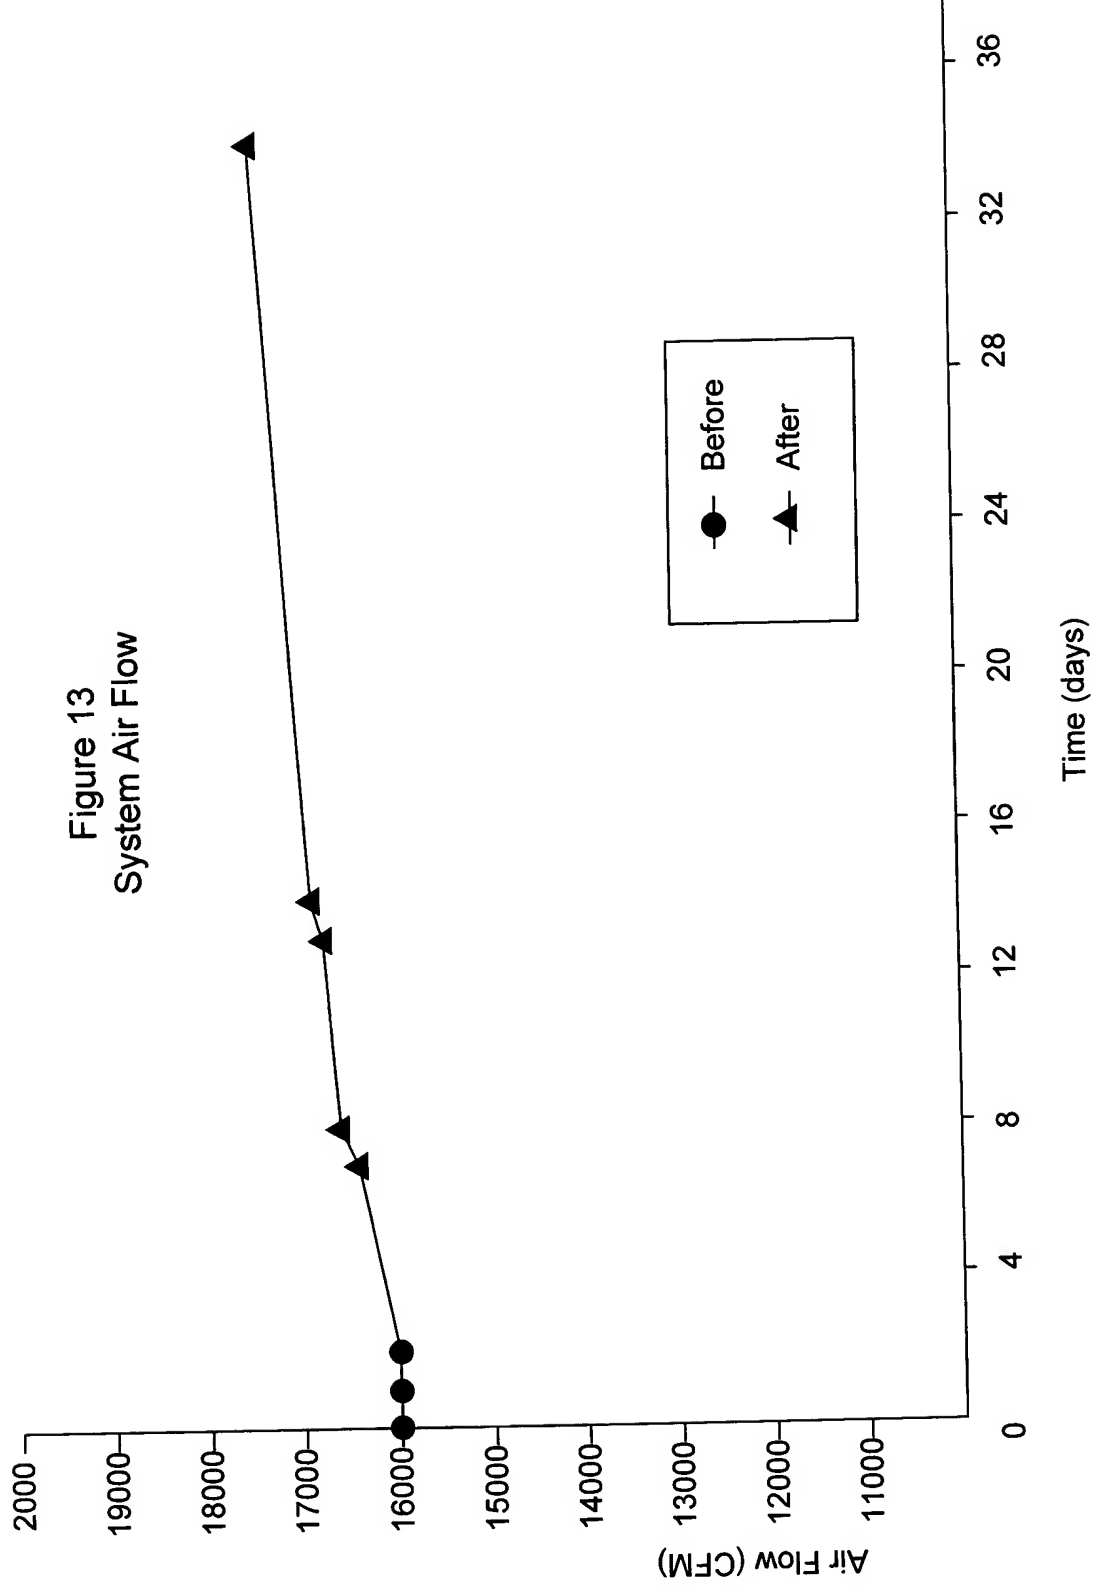


Figure 13
System Air Flow



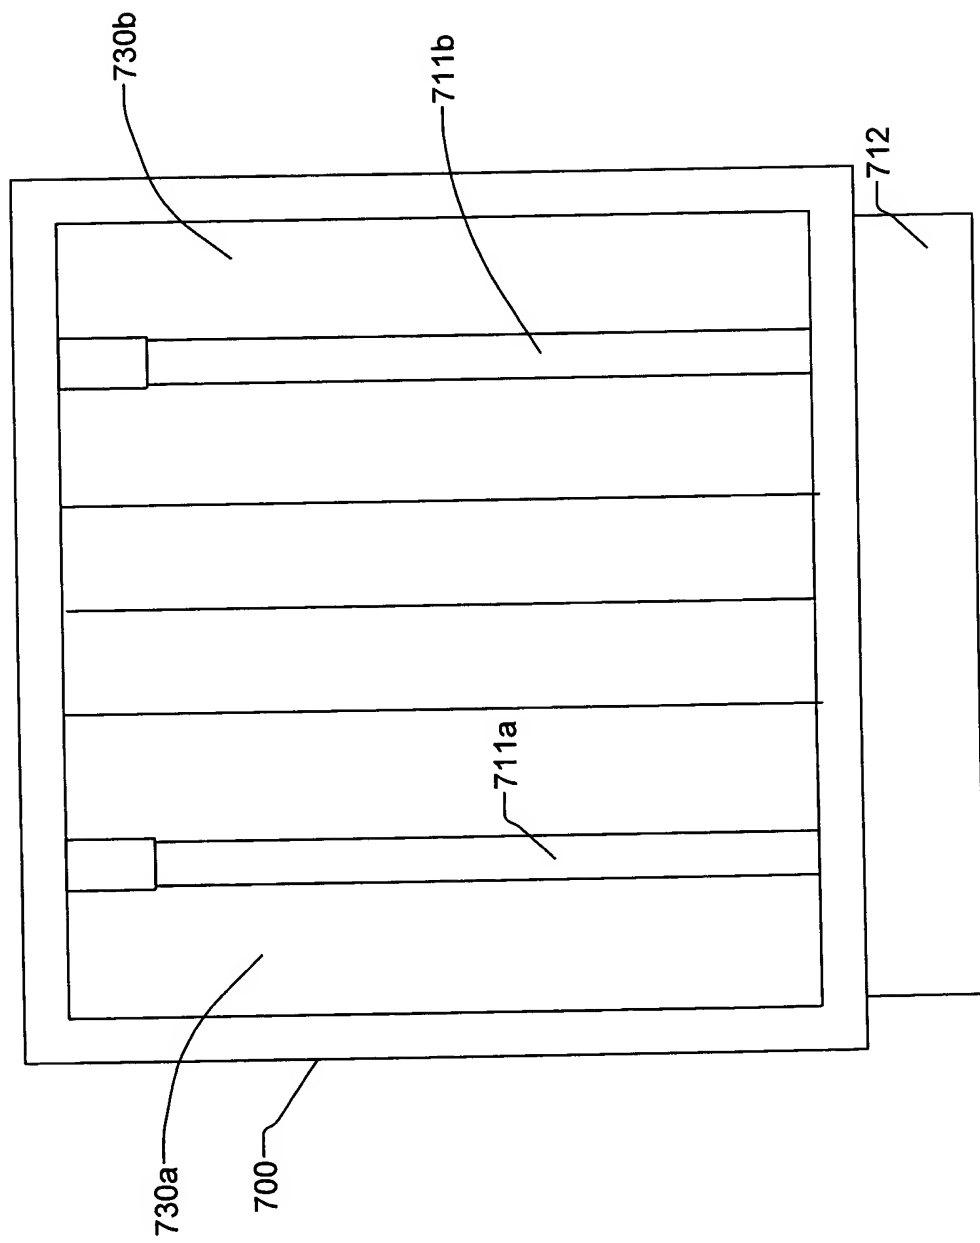


Figure 14

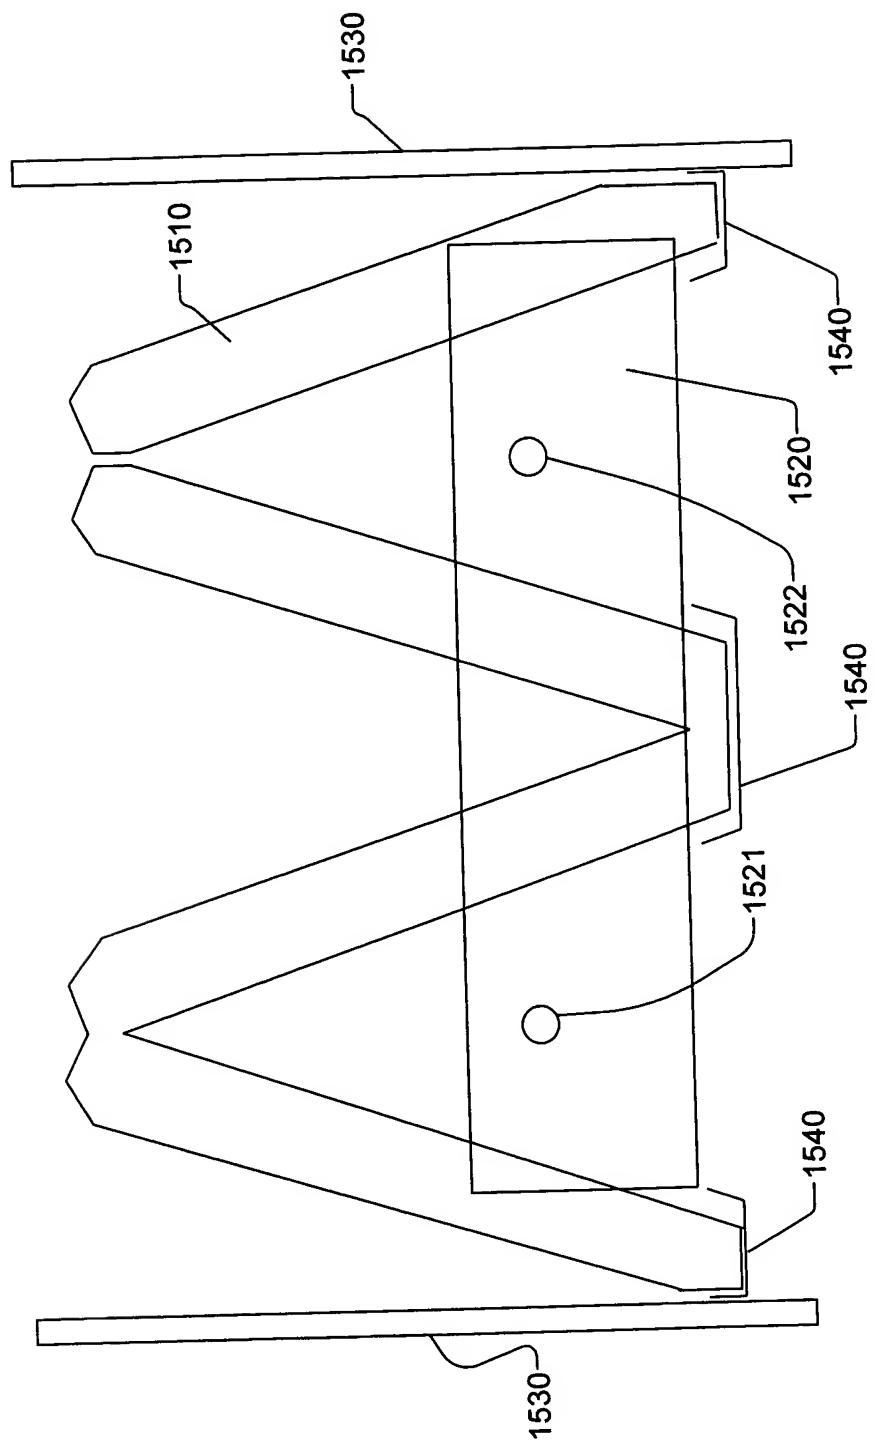


Figure 15

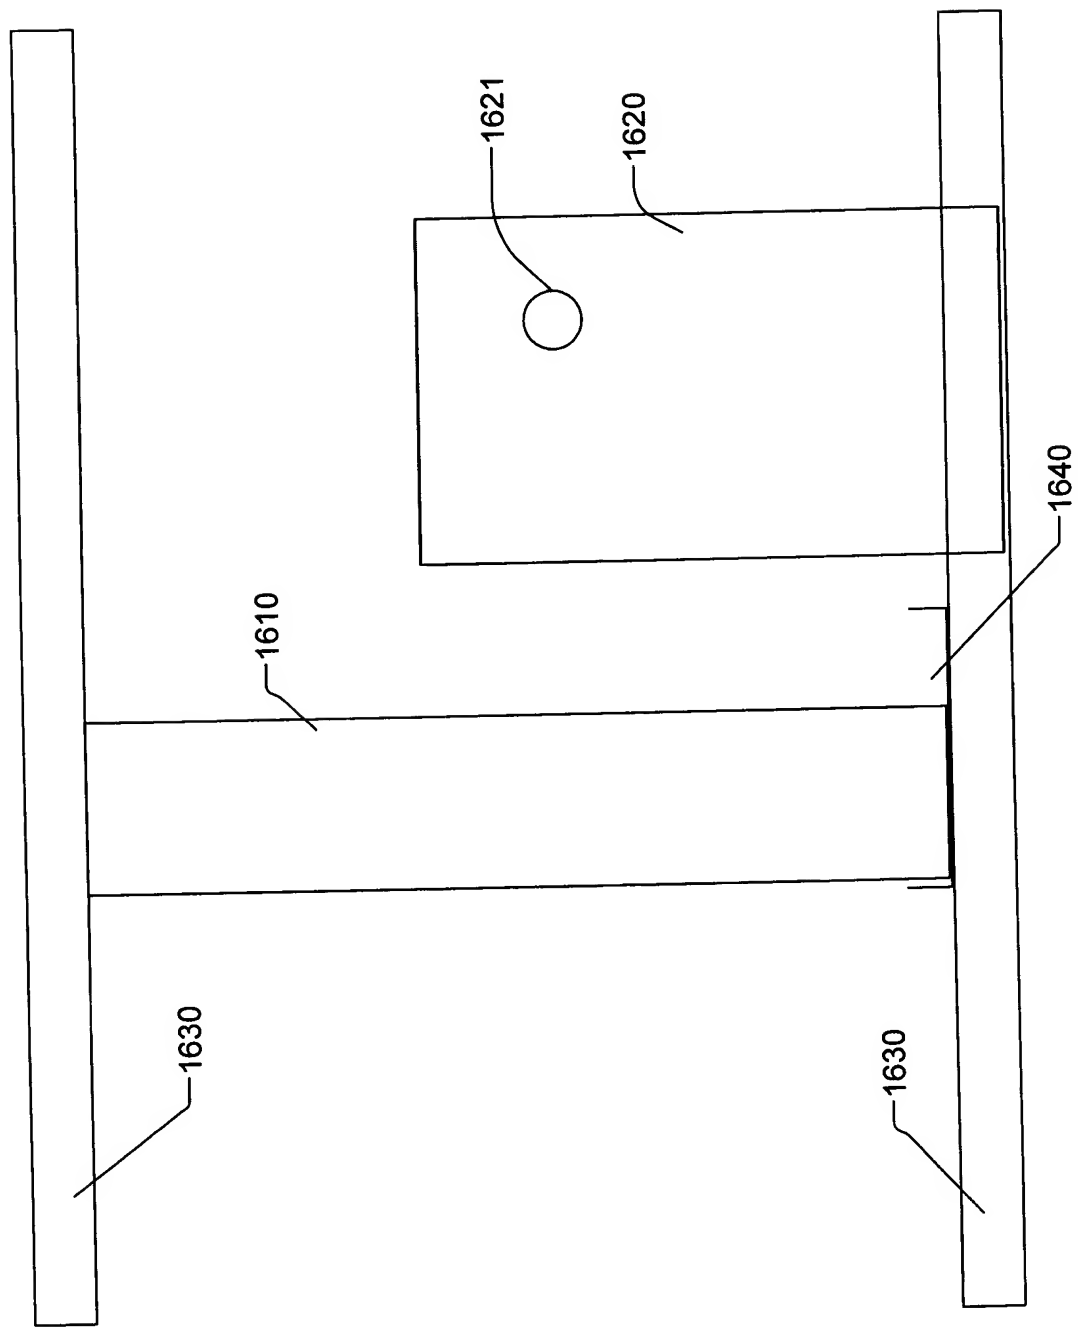


Figure 16

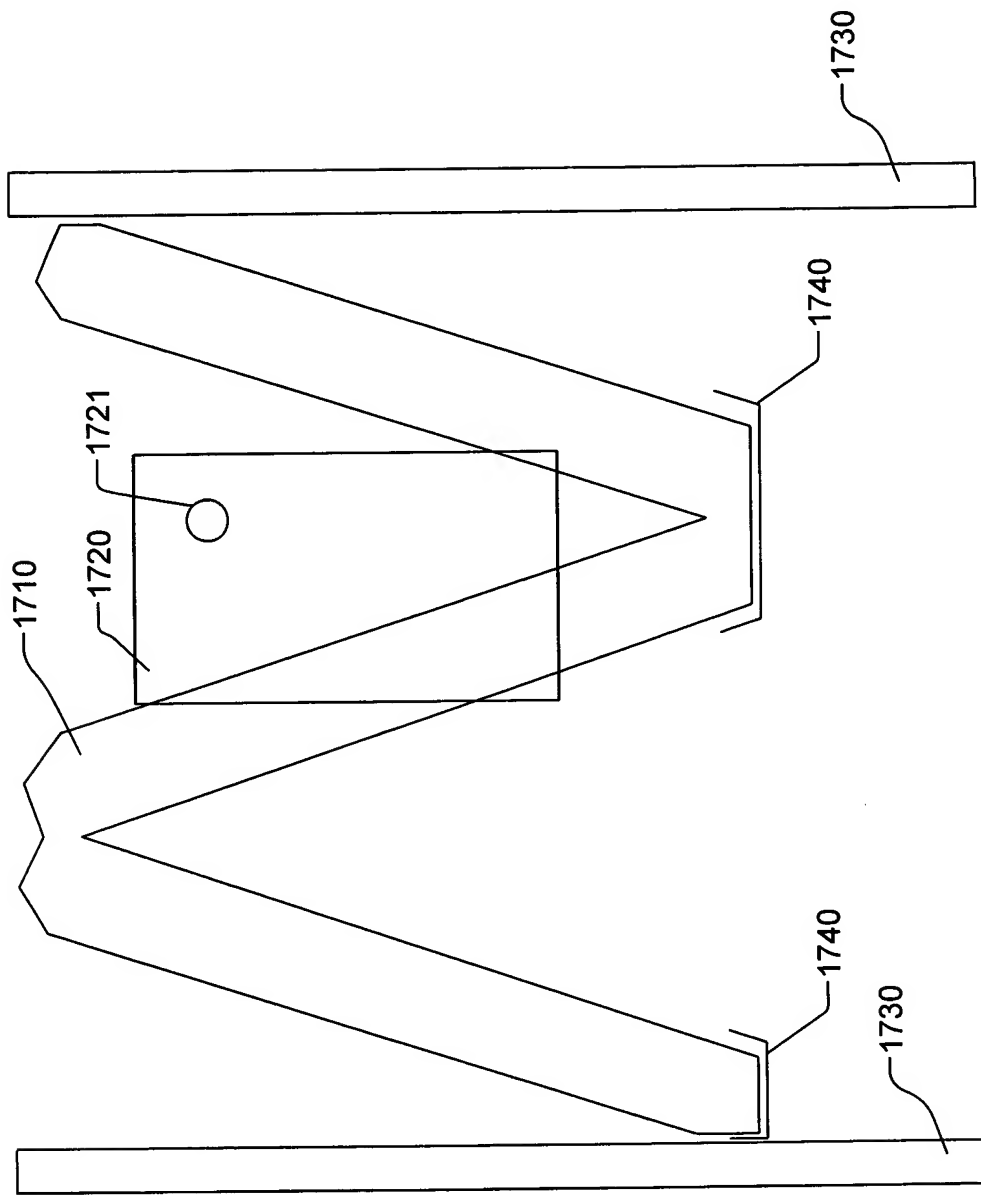


Figure 17

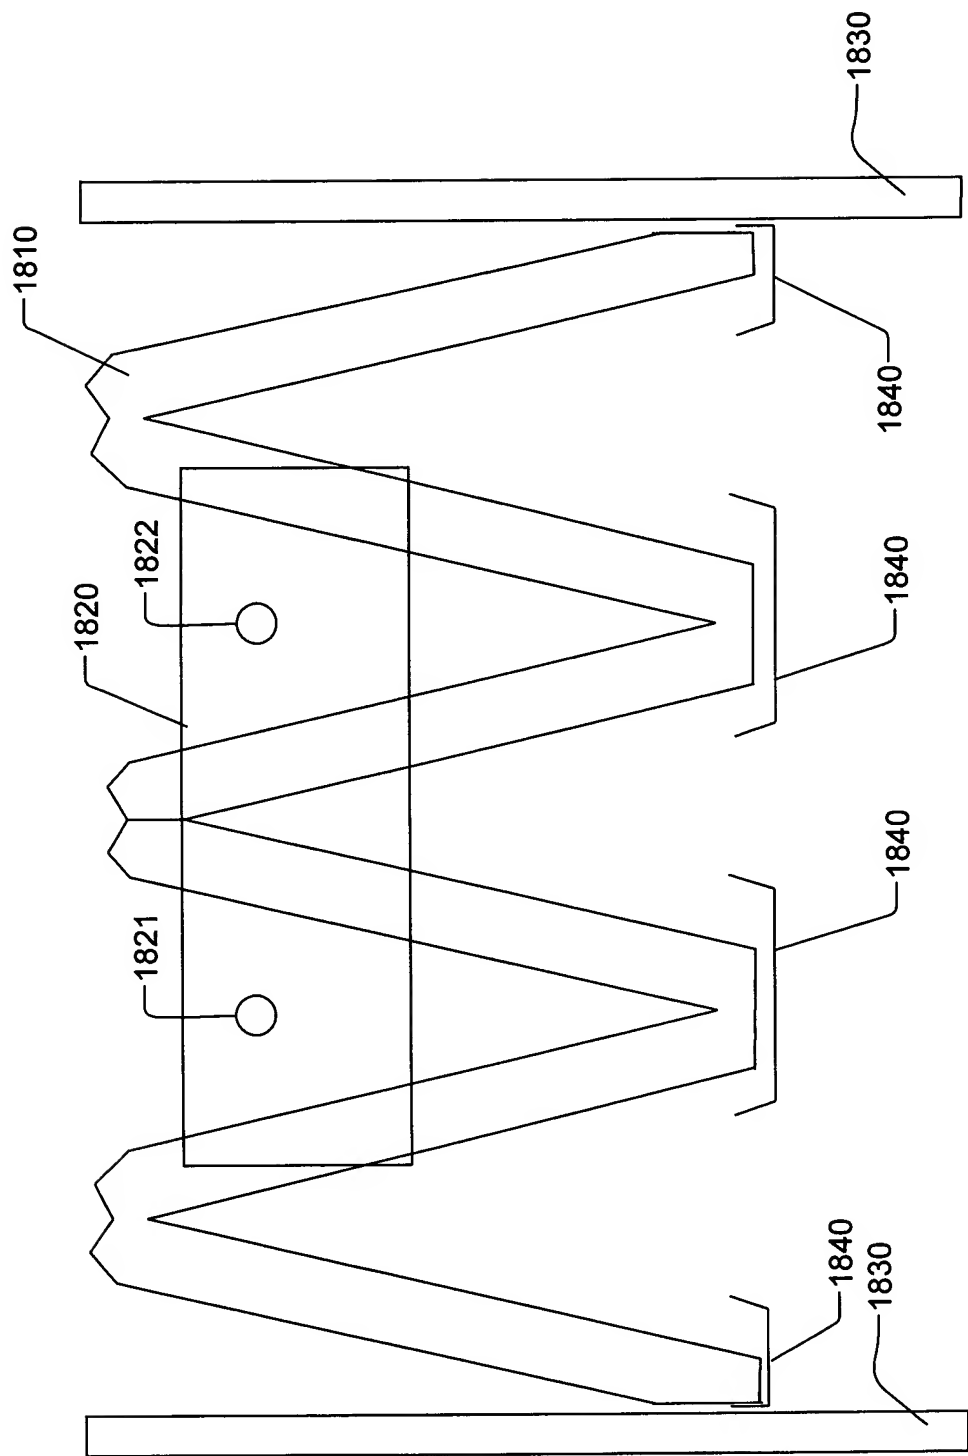


Figure 18